

Town of Georgetown, IN

Ordinance # G-10-16

FIRE SPRINKLER SERVICE ORDINANCE


BE IT ORDAINED BY THE TOWN COUNCEL OF THE TOWN OF GEORGETOWN, INDIANA (“GEORGETOWN”), THAT:

WHEREAS, the Georgetown Town Council (“Town Council”) desires to impose regulations promoting the use of fire sprinklers, to assure their safe use and installation, and to impose equitable fees associated with such use.

NOW THEREFORE BE IT ORDAINED:

1. That all fire sprinkler systems shall be installed with a valves to detect leakage and unauthorized water usage and to protect against the flow of nonpotable water into water supply lines. Such valves shall have a cast iron body and cover with replaceable bronze seats, with a maximum working pressure of 175 pounds per square inch (psi). Such valves shall have a temperature range of 330F – 1100 F (50C – 403C). Such valves shall have a hydrostatic test range of 350 psi. Moreover, they shall meet such reasonable specifications as directed by the Director of Public Works.
2. That the water service availability fees as established under Ordinances G-04-32, and G-01-10, and G-10-_____, setting the rates and charges for water usage including fees for capacity fees for new service tap ins, debt services fees, and that the same shall not apply to connections for fire sprinkler systems because there is no contemplate use of water associated with such systems, except for charging lines and for emergencies.
3. That all reasonable costs incurred by Georgetown to install and connect such service shall be paid prior to connection, in accordance with G-08-16 and §52.53 of the Georgetown Code of Ordinances.


So ORDAINED by the Town Council of the Town of Georgetown, Indiana, this
____ day of _____ 2010.

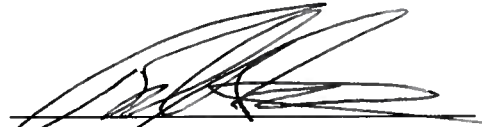

BILLY STEWART, PRESIDENT



MIKE MILLS, MEMBER



AARON STRIEGEL, MEMBER



EVERETT PULLEN, MEMBER



KARLA PERKINS, MEMBER

ATTEST:



DOUGLAS COOK, CLERK/TREASURER